

## DALI-2 CS Integration

DALI-2 CS THP

DALI-2 CS THP-AQ



### Datasheet

#### Combi Sensor Modul for Integration

DALI-2 sensor module for  
measurement of: motion  
and light intensity

**additional for DALI-2 CS THP**  
temperature (T)  
relative humidity (H)  
air pressure (P)

**additional for DALI-2 CS THP-AQ**  
air quality (AQ)

Art. Nr. 86458670-INT  
Art. Nr. 86457786-INT  
Art. Nr. 86457786-INT-AQ

Detection range variants: -15, -O  
Colour variants: -W16, -B  
Installation type variants: -ZD,-AP,-LE

# DALI-2 Combi Sensor Integration

## Multifunctional Sensor Modul for Integration

### Overview

- Sensor module for Integration in systems with a central control or in combination with a DALI-2 CS Master (Art. Nr. 86458670) – [www.lunatone.com/en/product/dali-2-cs/](http://www.lunatone.com/en/product/dali-2-cs/)
- **DALI-2 CS Integration** (Art. Nr. 86458670-INT) for measurement of motion and light intensity
- **DALI-2 CS THP Integration** (Art. Nr.: 86457786-INT) sensor module for measuring movement, light intensity, temperature (**T**), relative humidity (**H**), and air pressure (**P**)
- **DALI-2 CS THP-AQ Integration** (Art. Nr.: 86457786-INT-AQ) sensor module for measuring movement, light intensity, temperature (**T**), relative humidity (**H**), air pressure (**P**) and air quality (**AQ**)
- Easy configuration via DALI-Cockpit Software Tool and Lunatone DALI USB interface.
- Several sensor modules can be installed within a DALI system.
- Supply via the DALI bus, no additional power supply needed.
- Doubled terminals for easy installation
- DALI -2 Instance types  
 motion detection (PIR), instance type 3 (62386-303)  
 light intensity measurement, instance type 4 (62386-304)  
 temperature measurement, instance type 0 (62386-103)  
 relative humidity measurement, instance type 0 (62386-103)  
 air pressure measurement, instance type 0 (62386-103)  
 air quality measurement, instance type 0 (62386-103)  
 eCO2 measurement, instance type 0 (62386-103)
- Optimized variants for different applications and detection areas (hall, office) available
- Version for integration in luminaires available (Art. Nr. 86457786-INT-LE, Art. Nr. 86457786-INT-AQ-LE)



Specification, Characteristics

**DALI-2 CS Integration: measurement of motion and light intensity**

ARTICLE BASIS	SENSOR, detection range & mounting height	COLOUR	INSTALLATION TYPE
86458670-INT	<ul style="list-style-type: none"> <li>= standard, 12m &amp; 8m</li> <li><b>15</b> = especially for high rooms, 15m &amp; 12m</li> <li><b>O</b> = Detection of minor movements, 2.3m / 3m &amp; 3m</li> </ul>	<ul style="list-style-type: none"> <li>= RAL 9010</li> <li><b>W16</b> = RAL 9016</li> <li><b>B</b> = black</li> </ul>	<ul style="list-style-type: none"> <li>= installation box</li> <li><b>ZD</b> = suspended ceiling type with clasp</li> <li><b>AP</b> = surface mounting type</li> </ul>

**DALI-2 CS THP Integration: measurement of motion, light intensity, temperature, humidity, air pressure and optional air quality (version -AQ)**

ARTICLE BASIS	MEASURED VALUES	SENSOR, detection range & mounting height	COLOUR	INSTALLATION TYPE
86457786-INT	<ul style="list-style-type: none"> <li>= Temperature, humidity, air pressure</li> <li><b>AQ</b> = Temperature, humidity, air pressure and air quality</li> </ul>	<ul style="list-style-type: none"> <li>= standard, 12m &amp; 8m</li> <li><b>15</b> = especially for high rooms, 15m &amp; 12m</li> <li><b>O</b> = Detection of minor movements, 2.3m / 3m &amp; 3m</li> </ul>	<ul style="list-style-type: none"> <li>= RAL 9010</li> <li><b>W16</b> = RAL 9016</li> <li><b>B</b> = black</li> </ul>	<ul style="list-style-type: none"> <li>= installation box</li> <li><b>ZD</b> = suspended ceiling type with clasp</li> <li><b>AP</b> = surface mounting type</li> </ul>

Lens types:

**Standard**  
Long Distance Detection - Standard  
Art.Nr.: 86458670-INT-\_  
Art.Nr.: 86457786-INT-\_

**15**  
High Density, Long Distance Detection  
Art.Nr.: 86458670-INT-\_-15-\_  
Art.Nr.: 86457786-INT-\_-15-\_  
  
**For installation heights of up to 17m!**

**O**  
Slight Motion Detection  
Art.Nr.: 86458670-INT-\_-O-\_  
Art.Nr.: 86457786-INT-\_-O-\_

Installation types:

**Standard version with mounting holes**  
Art.Nr.: 86458670-INT-\_  
Art.Nr.: 86457786-INT-\_

**ZD** Version for suspended ceilings (with spring)  
Art.Nr.: 86458670-INT-\_-ZD-\_  
Art.Nr.: 86457786-INT-\_-ZD-\_

**AP** Version for surface mounting (with backbox)  
Art.Nr.: 86458670-INT-\_-AP-\_  
Art.Nr.: 86457786-INT-\_-AP-\_

type	DALI-2 CS THP and DALI-2 CS THP-AQ		
application	standard	hall	office
article number	86458670-INT 86457786-INT 86457786-INT-AQ	86458670-INT-15 86457786-INT-15 86457786-INT-AQ-15	86458670-INT-O 86457786-INT-O 86457786-INT-AQ-O

<b>electrical data:</b>	
supply	via DALI signal line (DALI-voltage according IEC62386)
marking terminals	DA, DA
typical current consumption DALI	3.5 mA
power consumption	<100mW
control	DALI-2


<b>insulation data:</b>	
impulse voltage category	II
pollution degree	2
rated insulation voltage	250V
rated impulse withstanding voltage	4kV
insulation DALI/housing	reinforced isolation
insulation test voltage	3000Vac

<b>environmental conditions:</b>			
storing and transportation temperature	-20°C ... +70°C		
operational ambient temperature	-20°C ... +60°C	-20°C ... +55°C	-20°C ... +60°C
rel. humidity, none condensing	15% ... 90%		


<b>technical data:</b>																				
Motion Detection (62386 -303) principle	PIR	PIR	PIR																	
detection range (at >8°C temperature difference)	12m	15m	3m /2.3m																	
typical mounting height	8m	12m	3m																	
zones	92	128	36 / 48																	
horizontal	±51°	±34,5°	±44°/±90°																	
vertical	±46°	±34,5°	±44°/±90°																	
min. temperature difference	>4°C	>4°C	>4°C																	
details	Figure. 1, page 8	Figure. 2, page 8	Figure. 3, page 9																	
light sensor (62386-304)	range: 0-2046lux (11bit), resolution: 1lux events: 0-2046lux(10bit), resolution: 2lux																			
temperature sensor (62386-103)	for <b>CS THP</b> and <b>CS THP-AQ</b> range: -20°C ... 80°C, resolution: 0,1°C																			
humidity sensor (62386-103)	for <b>CS THP</b> and <b>CS THP-AQ</b> range: 0% ... 100%, resolution: 0,1%																			
Air pressure sensor (62386-103)	for <b>CS THP</b> and <b>CS THP-AQ</b> range: 300hPa ... 1100hPa, resolution: 1hPa																			
air quality sensor (62386-103)	for <b>CS THP-AQ</b> range: 0 ... 500, resolution: 1																			
	<table border="1"> <thead> <tr> <th>index</th> <th>air quality</th> </tr> </thead> <tbody> <tr> <td>0 - 50</td> <td>excellent</td> </tr> <tr> <td>51- 100</td> <td>good</td> </tr> <tr> <td>101 - 150</td> <td>lightly polluted</td> </tr> <tr> <td>151 - 200</td> <td>moderately polluted</td> </tr> </tbody> </table>	index	air quality	0 - 50	excellent	51- 100	good	101 - 150	lightly polluted	151 - 200	moderately polluted	<table border="1"> <thead> <tr> <th>index</th> <th>air quality</th> </tr> </thead> <tbody> <tr> <td>201 – 250</td> <td>heavily polluted</td> </tr> <tr> <td>251 -350</td> <td>severely polluted</td> </tr> <tr> <td>&gt; 351</td> <td>extremely polluted</td> </tr> </tbody> </table>	index	air quality	201 – 250	heavily polluted	251 -350	severely polluted	> 351	extremely polluted
index	air quality																			
0 - 50	excellent																			
51- 100	good																			
101 - 150	lightly polluted																			
151 - 200	moderately polluted																			
index	air quality																			
201 – 250	heavily polluted																			
251 -350	severely polluted																			
> 351	extremely polluted																			
eCO2 sensor (CO2 equivalent) (62386-103)	for <b>CS THP-AQ</b> range: 0ppm ... 8000ppm, resolution: 10ppm																			
	<table border="1"> <thead> <tr> <th>ppm</th> <th>air quality</th> </tr> </thead> <tbody> <tr> <td>0 - 350</td> <td>excellent</td> </tr> <tr> <td>351- 700</td> <td>good</td> </tr> <tr> <td>701 - 1000</td> <td>lightly polluted</td> </tr> <tr> <td>1001 – 1500</td> <td>moderately polluted</td> </tr> </tbody> </table>	ppm	air quality	0 - 350	excellent	351- 700	good	701 - 1000	lightly polluted	1001 – 1500	moderately polluted	<table border="1"> <thead> <tr> <th>ppm</th> <th>air quality</th> </tr> </thead> <tbody> <tr> <td>1501 -2500</td> <td>heavily polluted</td> </tr> <tr> <td>2501-5000</td> <td>severely polluted</td> </tr> <tr> <td>5001-8000</td> <td>extremely polluted</td> </tr> </tbody> </table>	ppm	air quality	1501 -2500	heavily polluted	2501-5000	severely polluted	5001-8000	extremely polluted
ppm	air quality																			
0 - 350	excellent																			
351- 700	good																			
701 - 1000	lightly polluted																			
1001 – 1500	moderately polluted																			
ppm	air quality																			
1501 -2500	heavily polluted																			
2501-5000	severely polluted																			
5001-8000	extremely polluted																			

**general data:**


protection class	II in intended use
protection degree	IP20
mounting	back box – dimensions see below surface mounted (article number extension „-AP“) – dimensions below suspended ceiling (article number extension „-ZD“) – dimensions below
available colours	RAL9010 RAL9016 (article number extension “-W16”) Black (article number extension “-B”)
DALI-2 functionality	Integration – instance mode

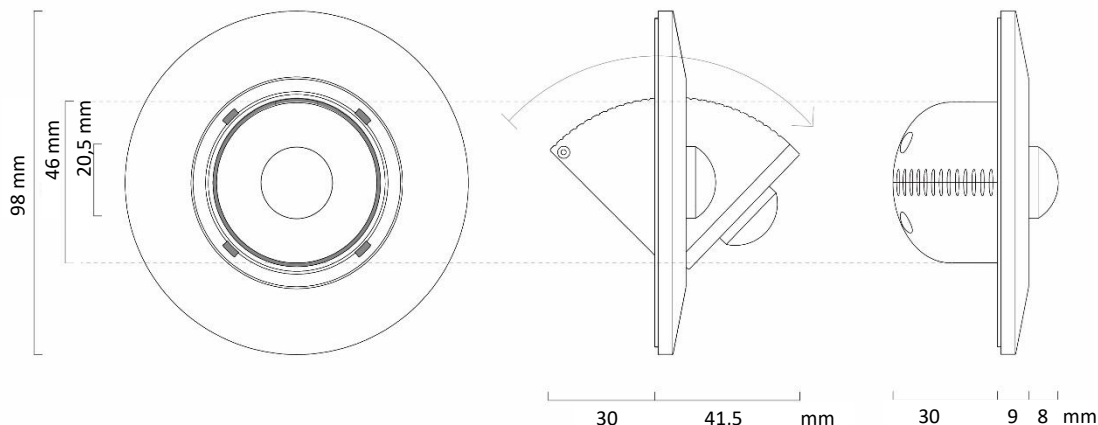


dimensions and space requirements

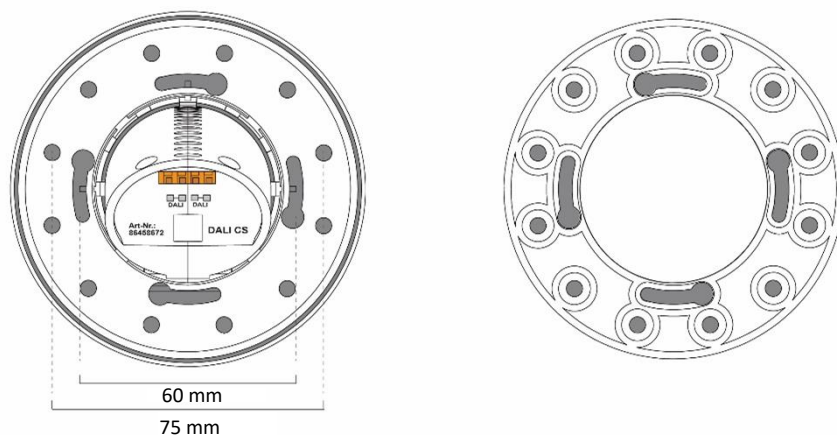

dimensions mounting ring

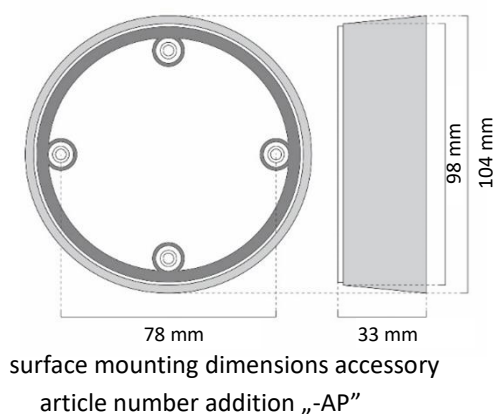

surface mounting dimensions accessory  
article number addition „-AP“

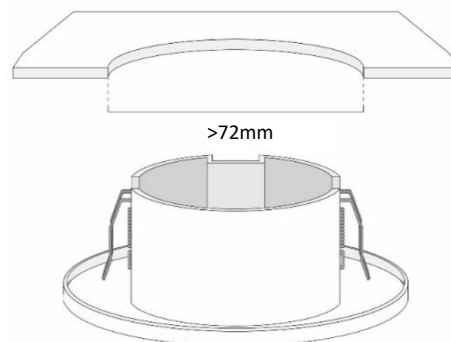

suspended ceiling mounting hole diameter  
article number addition „-ZD“

Specification, Characteristics - Version Luminaire installation



**DALI-2 CS THP Integration – for installation in luminaires:** measurement of motion, light intensity, temperature, humidity, air pressure and optional air quality (-AQ)



<b>type</b>	<b>DALI-2 CS THP Luminaire installation</b> <b>DALI-2 CS THP-AQ Luminaire installation</b>
article number	86457786-INT-LE 86457786-INT-AQ-LE

**electrical data:**

supply	via DALI signal line (DALI-voltage according IEC62386)
marking terminals	-
typical current consumption DALI	< 3.5 mA
power consumption	<100mW
control	DALI-2

**insulation data:**

impulse voltage category	II
pollution degree	2
rated insulation voltage	250V
rated impulse withstanding voltage	4kV
insulation DALI/housing	reinforced isolation
insulation test voltage	3000Vac

**environmental conditions:**

storing and transportation temperature	-20°C ... +70°C
operational ambient temperature	-20°C ... +60°C
rel. humidity, none condensing	15% ... 90%


**technical data:**

Motion Detection (62386 -303)	
principle	PIR
detection range (at >8°C temperature difference)	7m
typical mounting height	3m
zones	32
horizontal	±45°
vertical	±45°
min. temperature difference	>4°C
details	Figure. 4, page 9
light sensor (62386-304)	range: 0-2046lux (11bit), resolution: 1lux

	event: 0-2046lux(10bit), resolution: 2lux			
temperature sensor (62386-103)	for <b>CS THP</b> and <b>CS THP-AQ</b> range: -20°C ... 80°C, resolution: 0,1°C			
humidity sensor (62386-302)	for <b>CS THP</b> and <b>CS THP-AQ</b> range: 0% ... 100%, resolution: 0,1%			
Air pressure sensor (62386-103)	for <b>CS THP</b> and <b>CS THP-AQ</b> range: 300hPa ... 1100hPa, resolution: 1hPa			
air quality sensor (62386-103)	for <b>CS THP-AQ</b> range: 0 ... 500, resolution: 1			
	<b>index</b>	<b>air quality</b>	<b>index</b>	<b>air quality</b>
	0 - 50	excellent	201 – 250	heavily polluted
	51- 100	good	251 -350	severely polluted
	101 - 150	lightly polluted	> 351	extremely polluted
	151 - 200	moderately polluted		
eCO2 sensor (CO2 equivalent) (62386-103)	for <b>CS THP-AQ</b> range: 0ppm ... 8000ppm, resolution: 10ppm			
	<b>ppm</b>	<b>air quality</b>	<b>ppm</b>	<b>air quality</b>
	0 - 350	excellent	1501 -2500	heavily polluted
	351- 700	good	2501-5000	severely polluted
	701 - 1000	lightly polluted	5001-8000	extremely polluted
	1001 – 1500	moderately polluted		


**general data:**

protection class	II in intended use
protection degree	IP20
mounting	Luminaire installation – dimensions see below
available colours	black RAL9016 (article number extension “-W16”)
DALI-2 functionality	integration – instance mode

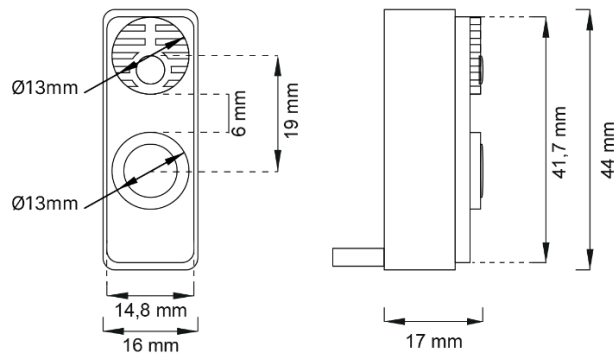

dimensions and space requirements – luminaire installation- article number extension „-LE“

**Application example**

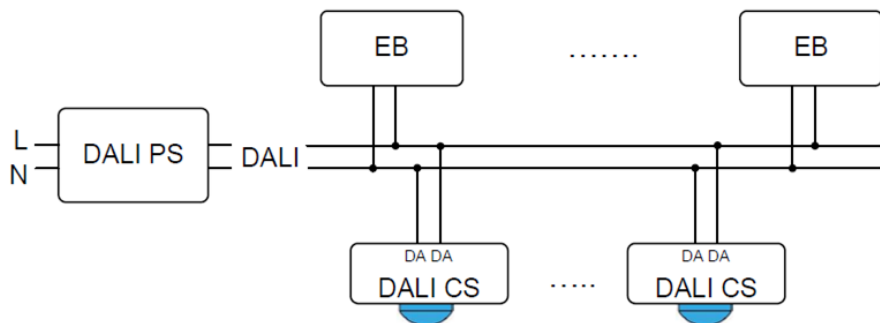

typical application: several sensors on one DALI-line

Sensor types

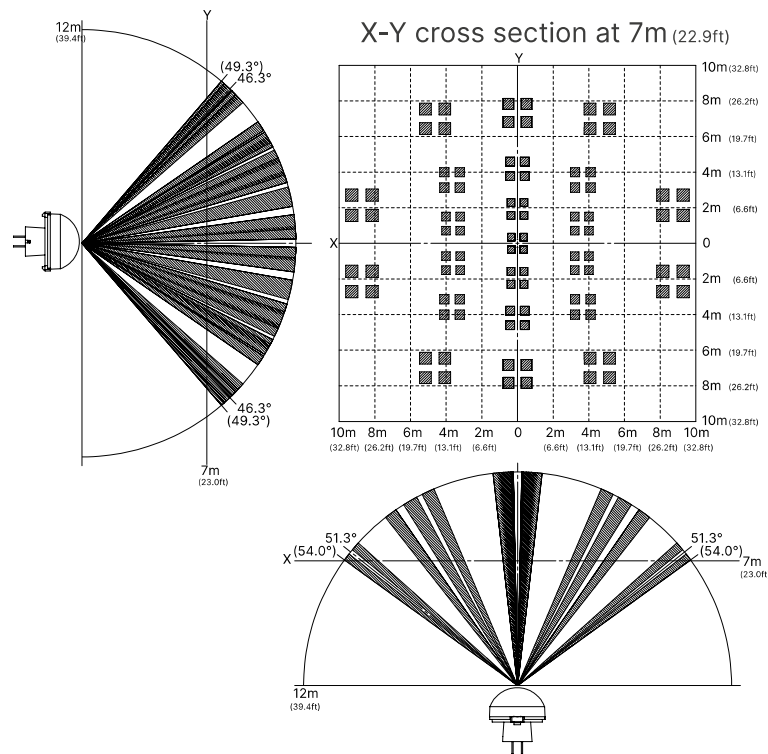


Figure. 1 **CS: Standard** motion detection (Art.Nr. 86458670-INT, Art. Nr.: 86457786-INT, Art. Nr.: 86457786-INT-AQ) Detection area: X-Y cross section at 7m

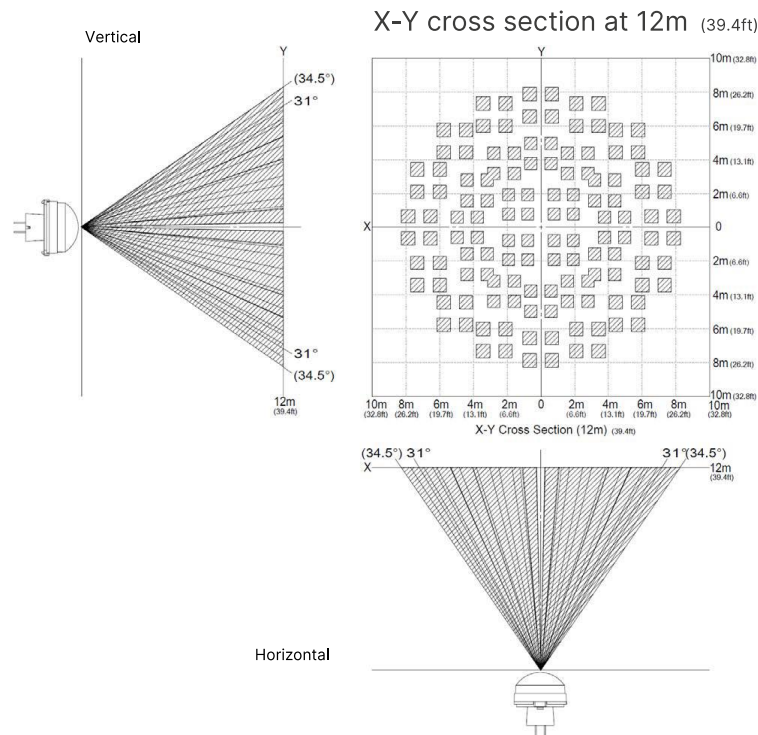


Figure. 2 **CS-15: Hall** motion detection (Art.Nr. 86458670-INT-15, Art. Nr.: 86457786-INT-15, Art. Nr.: 86457786-INT-AQ-15) High density long distance detection type



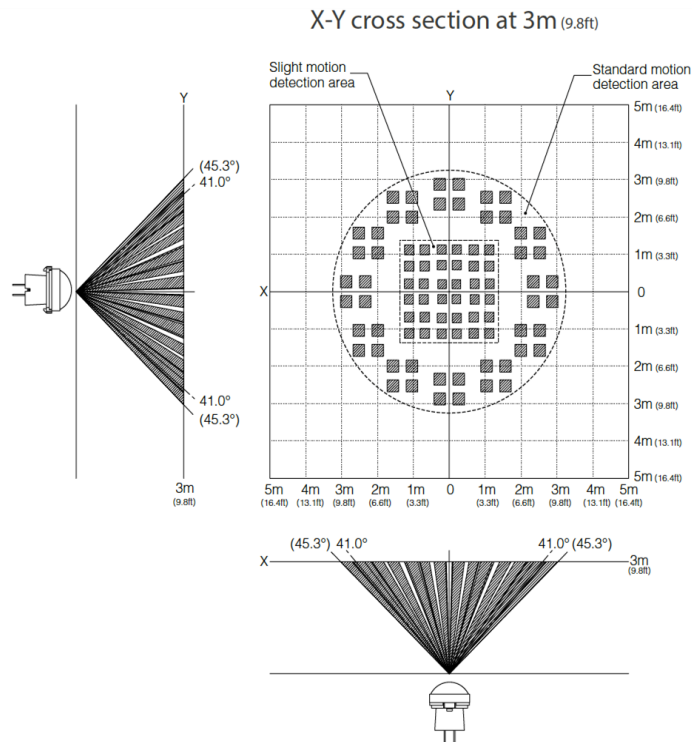


Figure. 3 **CS-O: Office motion detection** (Art. Nr.: 86458670-INT-O und Art. Nr.: 86457786-INT-O, Art. Nr.: 86457786-INT-AQ-O) Detection area: X-Y cross section at 3m - The rectangular centre zone is optimized for detecting smallest movements.

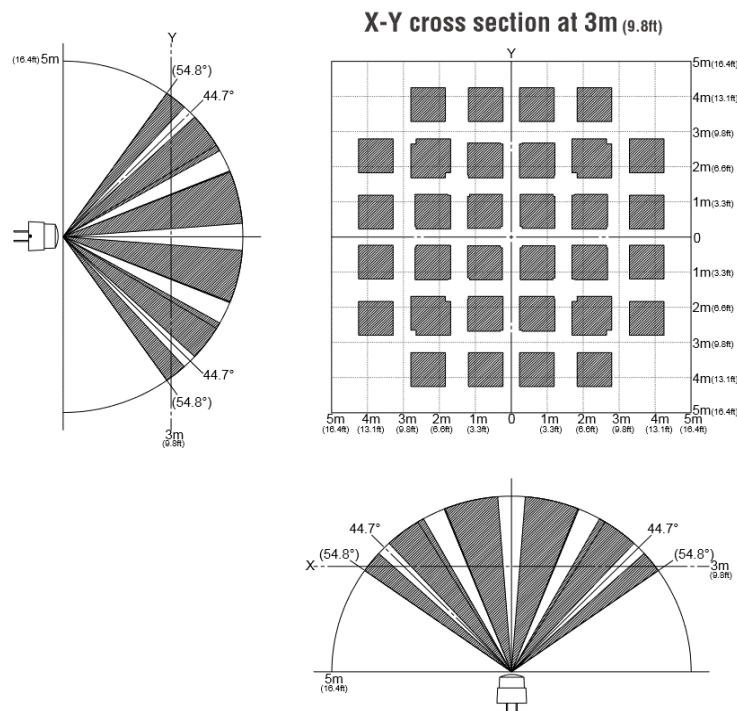


Figure. 4 **CS-LE: luminaire installation: motion detection** (Art. Nr.: 86457786-INT-LE, Art. Nr.: 86457786-INT-AQ-LE) Detection area: X-Y cross section at 3m.

## Factory Setting

For combination with the DALI-2 CS as Master the factory settings are sufficient. The device configuration can be changed via the [DALI Cockpit](#) and adapted to the current application.

Front-LED (motion indication)	inactive
Event Nachrichten:	
Motion	active
Light	active
Temperature	inactive
Humidity	inactive
Air pressure	inactive
Air quality	inactive
eCO2	inactive

The following instance settings are the delivery default and are necessary in combination with a DALI-2 CS Master. In combination with a central control unit, the specifications of the central control unit need to be followed (especially with regard to the event schema).

### Instance No. 0 – Motion:

Event messages	active
Event Schema	device addressing
Event Filter	Occupied Vacant
Deat time	0.00 sec
Report time	not applicable
Hold time	1 sec

### Instance No. 1– light:

Event messages	active
Event Schema	device addressing
Event Filter	illuminance level
Deat time	0.8 sec
Report time	unused
Hysteresis Min	5 Lux
Hysteresis	5 %

### Instance No. 2 – Temperature

### Instance No. 3 – Luftfeuchtigkeit

### Instance No. 4 – Luftdruck

### Instance No. 5 – Luftqualität

### Instance No. 6 – eCO2:

Event messages	inactive
Event Schema	device addressing
Event Filter	sensor value
Deat time	1.5 sec
Report time	unused
Hysteresis Min	2 (°C%/hPa/ )
Event messages	5 %

For general information on DALI instances see also the ["DALI-2 Instance guide"](#).

## Installation

- the DALI-2 CS is directly connected and supplied by the DALI bus. A general DALI bus power supply is required
- The connection to the DALI terminals can be made regardless of polarity.
- The terminals are suitable for wire cross-sections ranging from 0.5 mm<sup>2</sup> to 1.5 mm<sup>2</sup>.
- back box mounting: installation of the mounting ring directly on the back box. The housing is then simply plugged onto the mounting ring. The recessed head has sufficient space within the electrical installation box enabling a completely flat installation.
- The CS Module enables alignment to the desired detection area through 360 ° axial rotation and vertical inclination of up to 40°.
- For mounting the sensor on cavity walls or suspended ceilings a version including additional fixtures with spring-clips is available: article number extension “-ZD”.
- Version for surface mounting is available: article number extension “-AP”.
- Version integration in luminaires is available (Art.Nr.: 86457786-INT-LE, Art.Nr.: 86457786-INT-AQ-LE)
- The wiring should be carried out as a permanent installation in a dry and clean environment.
- Installation may only be carried out in a voltage-free state of the system and by qualified specialists.
- National regulations for setting up electrical systems must be followed.
- The DALI wiring can be realized with standard low-voltage installation material. No special cables are required.
- Only 1 wire may be connected to each terminal. When using double wire end ferrules, the connection capacity of the terminal must be considered.



**Attention:** The DALI-signal is not classified as SELV circuit (Safety Extra Low Voltage). Therefore, the installation regulations for low voltage apply.




**Note:** The cross section: the voltage drop on the DALI line must not exceed 2V at maximum length (300m) and maximum bus load (250mA).

## Presence Detection

For movement detection a temperature difference between the moving object and environment of at least 4°C is required. Heat sources such as copiers or heaters may have a negative influence on motion detection.

### **Presence Detection (Standard)**

The applied PIR method allows coverage of relatively large areas using only one sensor head. With opening angles of 92° and 102° and a sensor mounted at a height of 5 meters the 92 detection zones cover an area of more than 100m<sup>2</sup>. The distance between sensor and the object of interest should be less than 12 meters, which limits the mounting height to about 8m. See Figure. 1, page 8 und table 1 below.

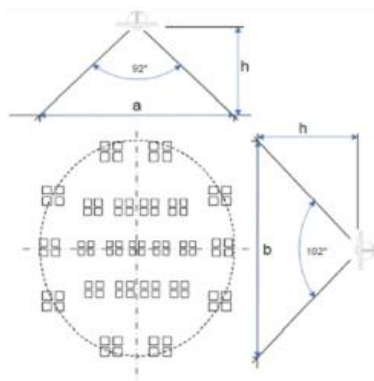

h [m]	a [m]	b [m]	A [m <sup>2</sup> ]
2,50	5,2	6,2	25,1
2,7	5,6	6,7	29,3
3,0	6,2	7,4	36,2
3,5	7,2	8,6	49,2
4,0	8,3	9,9	64,3
5,0	10,4	12,3	100,4
6,0	12,4	14,8	144,6
8,0	16,6	19,8	257,1

table. 1 CS-Standard: relation of mounting height and detection area

**Presence Detection CS-15**

The sensor type „-15“ is suitable for high rooms (e.g. halls) with mounting height up to 12m. The detection range is about 15m. See Figure. 2, page 8 and table 2 below.

h [m]	a [m]	b [m]	A [m <sup>2</sup> ]
5,0	6,9	6,9	37,1
7,5	10,3	10,3	83,5
10,0	13,7	13,7	148,4
12,0	16,5	16,5	213,7

table. 2 CS- hall (15): relation of mounting height and detection area

**Presence Detection CS-O**

Suitable for office application where detection of slight motion is required e.g. detection of arm movement of a sitting person. The DALI CS-O is tailored to this application and has a sensitive “inner area” and a standard detection “outer area”. The maximum mounting height is about 3m. See Figure. 3, page 9.

The rectangular central zone is optimized for detection of the slightest motion. The area has an opening angle of 44° x 44° and 36 detection zones. With a mounting height of e.g. 2.2m, an area of 3.24 m<sup>2</sup> can be covered, see Figure. 5 and table 3.

The outer standard motion detection zone has an opening angle of 90° x 90° and 48 detection zones. With a mounting height of e.g. 2.2m, an area of 15.2m<sup>2</sup> can be covered. (see table 3).

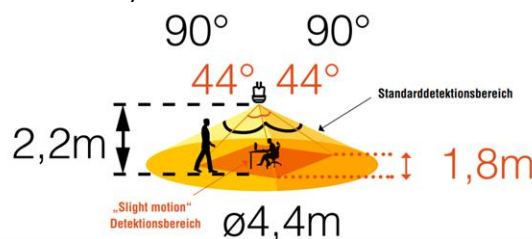


Figure. 5 CS-Office detection range

h [m]	Standard Detection area			Slight motion detection area	
	a [m]	b [m]	A1 [m <sup>2</sup> ]	l [m]	A2 [m <sup>2</sup> ]
2,0	4	4	12,5	1,6	2,56
2,2	4,4	4,4	15,2	1,8	3,24
2,5	5	5	19,6	2	4
3,0	6	6	28,2	2,4	5,76

table. 3 CS-Office: relation of mounting height and detection area

The recommended mounting height is 3m. The distance between the sensor and the object to detect should not be greater than 3.1m.

**Presence Detection CS-LE**

Der DALI-2 CS-LE has a PIR lens with opening angles of 110°x 110° und 32 detection zones. With a typical mounting height of 3m, over 25m<sup>2</sup> of surface can be covered, see Figure. 4, page 9. The distance between the sensor and the object to be detected should be a maximum of 5m.

## Functionality

The *DALI-2 CS Integration* is for use in systems with higher-level controls, such as for example DALI-2 CS, WAGO, Beckhoff, LUNATONE DALI-2 KNX gateway, etc.. The measured values can either be queried or they can automatically trigger events. This functionality is implemented via DALI-2 instances.

Different versions with different sensors are available. The DALI-2 CS (Art. Nr.: 86458670-INT) has a motion sensor and a light intensity sensor. The DALI-2 CS THP (Art. Nr.: 86457786-INT) can also measure: temperature, humidity and air pressure. The DALI-2 CS THP-AQ (Art. Nr.: 86457786-INT-AQ) measures all previously listed values as well as air quality.

For each detectable sensor value a separate DALI-2 instance is implemented in the device. All instances are DALI-2 certified and comply with the DALI-2 standard.

The measured sensor instance values can either be queried via a "Query" command or sent as a DALI-2 event message.

Each instance can be activated or deactivated (independent of the other instances).

It is possible to assign all instances to one or several instance groups.

Die Eventpriorität ist für jede Instanz einzeln einstellbar, ebenso der Eventfilter, Deadtime und Reporttime.

The event priority can be set individually for each instance, as can the event filter, dead-time and report-time.

For general information on DALI instances see also the ["DALI-2 Instance guide"](#).

## Instances: General

Each instance can be configured individually. Some settings have the same functionality for all sensor instances and are therefore described in this section. Instance specific settings are explained for each individual instances in the following respective sections.

### **enable/disable**

If instances are not required, they can be deactivated. In this case, event messages are not sent, and the measured values are not updated. They can, however, still be queried via a "Query" command, and the DALI-2 configuration commands and queries are still supported.

### **Event Scheme**

The event scheme determines which information is transferred with the event. This information is required, to enable recognition and / filtering of events on the bus. The following 5 options are available:

- Instance addressing:  
*instance type and instance number*
- Device Addressing:  
*device address and instance type*
- Device/Instance Addressing:  
*device address and instance number*
- Device Group Addressing:  
*Device group and instance type*
- Instance Group Addressing:  
*Instance group and instance type*

### Instance group

Up to three instance groups can be assigned for each instance. Only the "Primary Group" is used for the event.

### Instance type

The instance type defines which DALI-2 standard is valid for this instance. (The different instance types are specified in the DALI-2 standard.)

#### Instance number

Each instance in a device has a unique instance number.

#### Device group

The device can be assigned to up to 32 device groups (0...31). The lowest device group is used for the event.

#### Device address

A device address (or short address) (0..63) can be assigned to each device. With this the device can be clearly addressed. (Identical short addresses should be avoided.)

#### **Event priority**

The event priority determines the order in which events are sent when they occur simultaneously on the bus. Priority 2 = highest and 5 = lowest.

#### **Dead Time**

The dead time can be set for each instance. It determines the time that must pass before an event can be sent again. This also applies if the event information (measured value) changes. If no dead time is required, it can be deactivated.

#### **Report Time**

If the event information does not change, the event is sent cyclically with the report time. The report time can be set for each instance. It determines the maximum time between a sent event and resending.

#### **Hysteresis**

Not every change in value leads to an event being generated. The hysteresis can be used to set which percentage change is necessary to trigger a new transmission. Attention, the hysteresis band is not arranged symmetrically. The following applies:

#### Increasing value:

The condition for an event is only fulfilled if the next value falls below the previous value minus the hysteresis or if the next value is greater than the previous value.

#### Decreasing value:

the condition for an event is only fulfilled if the next value exceeds the previous value plus the hysteresis or the next value is smaller than the previous value.

#### **Hysteresis Min**

Is the minimal hysteresis value that cannot be fallen below of.

#### Instance 0: Motion

Is an instance standardized by DALI-2 for motion detection (62386-303). All settings are implemented according to the standard. The instance is DALI-2 certified.

The sensor switches between the following states:

- People in the room and movement (0xFF)
- People in the room and no movement (0xAA)
- Empty room (0x00)

If the sensor detects movement, it immediately changes to the state: "people in the room and movement". This state is exited after 1 second at the earliest if no further movement is detected. In this case it changes to the state "People in the room and no movement". After the hold time has expired it changes to the state "Empty room".

**Hold Time:** Is the time that must pass before the state "people in the room and no movement" is changed to the state "empty room". If movement is detected during this time the state is changed back to: "People in the room and movement".

**Query Input Value:** The current sensor state can be queried using this DALI command. The following values are possible: 0x00, 0xAA, 0xFF (see paragraph above for the possible states)

**Event:** the sensor status is transmitted by events. The following event information is available:

- Bit0 = 0: No Movement
- Bit0 = 1: Movement
- Bit2/Bit1 = 00: Vacant
- Bit2/Bit1 = 10: Still Vacant
- Bit2/Bit1 = 01: Occupied
- Bit2/Bit1 = 11: Still Occupied
- Bit3 = 1: Movement Sensor
- Bit5..Bit9 = 0: unused

More details can be found in the standard 62386-303.

**Event filter:** The event filter defines for which status change an event is generated.

Filter arrangement:

- Bit0: Occupied Event active
- Bit1: Vacant Event active
- Bit2: Still Vacant/Occupied Event active
- Bit3: Movement Event active
- Bit4: No Movement Event active
- Bit5..Bit7: unused

## Instance 1: Light intensity

is an instance standardized by DALI-2 (62386-304). All settings are implemented according to the standard. The instance is DALI-2 certified.

The current light value (lux) is measured by the sensor and can either be queried using a "Query" command or can be automatically provided by the sensor using an event.

The measuring range is 0Lux ... 2046Lux. The resolution differs between queries and generated events. A query supports a

resolution of 1Lux (11Bit) and an event a resolution of 2Lux (10Bit).

**Hysteresis:** see chapter "*Instances General*" – "*Hysteresis*" page 14.

**Hysteresis Min:** set in lux. For general information see chapter "*Instances General*" - "*Hysteresis Min*" page 14.

**Event Filter:** if the filter is deactivated, no events will be sent.

## Instance 2: Temperature

Versions: CS THP and CS-THP-AQ

is an instance standardized by DALI-2 (62386-103), instance type 0, generic. All settings are implemented according to the standard. The instance is DALI-2 certified.

The current air temperature (°C) is measured by the sensor and can either be queried using a "Query" command or can be automatically provided by the sensor using an event. The measuring range is -20°C ... 80°C. The resolution for both query and event is 0.1°C (10Bit). The value 0dec corresponds to -20°C and the value 1000dec corresponds to 80°C.

**Hysteresis:** see chapter "*Instances General*" – "*Hysteresis*" page 14.

**Hysteresis Min:** set in °C. For general information see chapter "*Instances General*" - "*Hysteresis Min*" page 14.

**Event Filter:** if the filter is deactivated, no events will be sent.

### Instance 3: Humidity

Versions: CS THP and CS-THP-AQ

is an instance standardized by DALI-2 (62386-103), instance type 0, generic. All settings are implemented according to the standard. The instance is DALI-2 certified.

The current relative humidity (%) is measured by the sensor and can either be queried using a "Query" command or can be automatically provided by the sensor using an event. The measuring range is 0% ... 100%. The resolution for both query and event is 0.1% (10Bit). The value 0dec corresponds to 0% and the value 1000dec corresponds to 100%

**Hysteresis:** see chapter "*Instances General*" – "*Hysteresis*" page 14.

**Hysteresis Min:** set in %. For general information see chapter "*Instances General*" - "*Hysteresis Min*" page 14.

**Event Filter:** if the filter is deactivated, no events will be sent.

### Instance 4: air pressure

Versions: CS THP and CS-THP-AQ

is an instance standardized by DALI-2 (62386-103), instance type 0, generic. All settings are implemented according to the standard. The instance is DALI-2 certified.

The current air pressure (hPa) is measured by the sensor and can either be queried using a "Query" command or can be automatically provided by the sensor using an event. The measuring range is 300hPa ... 1100hPa. The resolution for both query and event is 1hPa (10Bit). The value 0dec corresponds to 300hPa and the value 800dec corresponds to 1100hPa.

**Hysteresis:** see chapter "*Instances General*" – "*Hysteresis*" page 14.

**Hysteresis Min:** set in hPa. For general information see chapter "*Instances General*" - "*Hysteresis Min*" page 14.

**Event Filter:** if the filter is deactivated, no events will be sent.

### Instance 5: air quality

Version: CS THP-AQ

is an instance standardized by DALI-2 (62386-103), instance type 0, generic. All settings are implemented according to the standard. The instance is DALI-2 certified.

The sensor measures the air quality based on the proportion of existing air pollution. The air quality is shown as an index, ranging from 0 ... 500. The following table describes the relationship between the index and air quality:







Index	Air quality	
0-50	Excellent	
51-100	Good	
101-150	Lightly polluted	
151-200	Moderately polluted	
201-250	Heavily polluted	
251-350	Severely polluted	
>351	Extremely polluted	

Table 4 on page 16 describes the possible impact and suggested counter measures in case of poor air quality.

**Hysteresis:** see chapter "*Instances General*" – "*Hysteresis*" page 14.

**Hysteresis Min:** set as index. For general information see chapter "*Instances General*" - "*Hysteresis Min*" page 14.

**Event Filter:** if the filter is deactivated, no events will be sent.



### Instance 6: eCO2 – CO2 equivalent

Version: CS THP-AQ

is an instance standardized by DALI-2 (62386-103), instance type 0, generic. All settings are implemented according to the standard. The instance is DALI-2 certified.

The sensor measures the air quality based on the proportion of existing air pollution. From the measured value the CO2 equivalent can be calculated: eCO2 value, ranging from 0ppm ... 8000ppm. The following table describes the relationship between the eCO2 value and air quality:

eCO2 (ppm)	air quality
0 - 350	Excellent
351- 700	Good
701 - 1000	Lightly polluted
1001 – 1500	Moderately polluted
1501-2500	Heavily polluted
2501-5000	Severely polluted
5001-8000	Extremely polluted

Table 4 on page 17 describes the possible impact and suggested counter measures in case of poor air quality.

**Hysteresis:** see chapter "*Instances General*" – "*Hysteresis*" page 14.

**Hysteresis Min:** set as index. For general information see chapter "*Instances General*" - "*Hysteresis Min*" page 14.

**Event Filter:** if the filter is deactivated, no events will be sent.

	Index	eCO2 (ppm)	Impact (long-term exposure)	Suggested action
	0-50	0 - 350	Pure air; best for well-being	No measures needed
	51-100	351- 700	No irritation or impact on well-being	No measures needed
	101-150	701 - 1000	Reduction of well-being possible	Ventilation suggested
	151-200	1001 – 1500	More significant irritation possible	Increase ventilation with clean air
	201-250	1501-2500	Exposition might lead to effects like headache depending on type of pollution	optimize ventilation
	251-350	2501-5000	More severe health issue possible if harmful substances are present	Contamination should be identified if level is reached even w/o presence of people; maximize ventilation & reduce attendance
	>351	5001-8000	Headaches, additional neurotoxic effects possible	Contamination needs to be identified; avoid presence in room and maximize ventilation

Table 4 impact and suggested action for different air quality index

## Delivery condition / factory setting

On delivery all instance events are active. Usage with a DALI-2 CS is possible without further configuration by assigning the devices to the DALI-2 CS Master.

## Configuration in the DALI-Cockpit

The DALI CS can be addressed and configured using the DALI-Cockpit PC software tool and a suitable interface to the DALI bus (e.g. DALI USB, DALI SCI RS232 or DALI4Net).

After the device has been addressed, the parameters can be adjusted to the user application.

The localisation of the sensor can be carried out by visual means. To do this, the checkbox: "localize" must be selected in the DALI cockpit in order to make the red LED integrated in the sensor flash.

The settings are distributed on different tabs:



### tab: „General“

see Figure. 6, page 19

The basic configuration can be made on the "General" tab.

### tab: „Instances“

See Figure. 7, page 19

Depending on the version up to 6 instances are available:

#### DALI-2 CS:

- Instance 0, motion detection
- Instance 1, light intensity

#### DALI-2 CS THP:

- Instance 0, motion detection
- Instance 1, light intensity
- Instance 2, temperature
- Instance 3, humidity
- Instance 4, air pressure

#### DALI-2 CS THP-AQ

- Instance 0, motion detection
- Instance 1, light intensity
- Instance 2, temperature
- Instance 3, humidity
- Instance 4, air pressure
- Instance 5, air quality
- Instance 6, eCO2

### tab: „Overview“

see Figure. 8, page 20

The overview shows which instances are activated / deactivated and enables periodic queries of the currently measured values.

In order to adjust the measured values, it is possible to set an offset value for temperature and relative humidity.

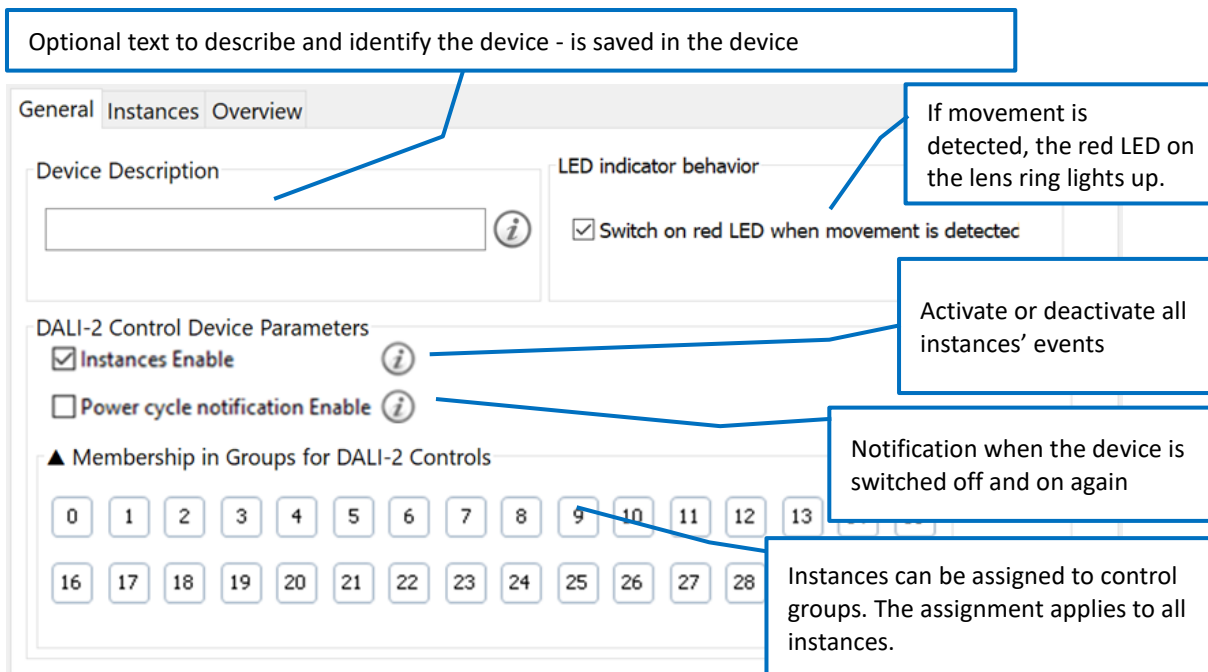


Figure. 6 Cockpit tab General - general settings

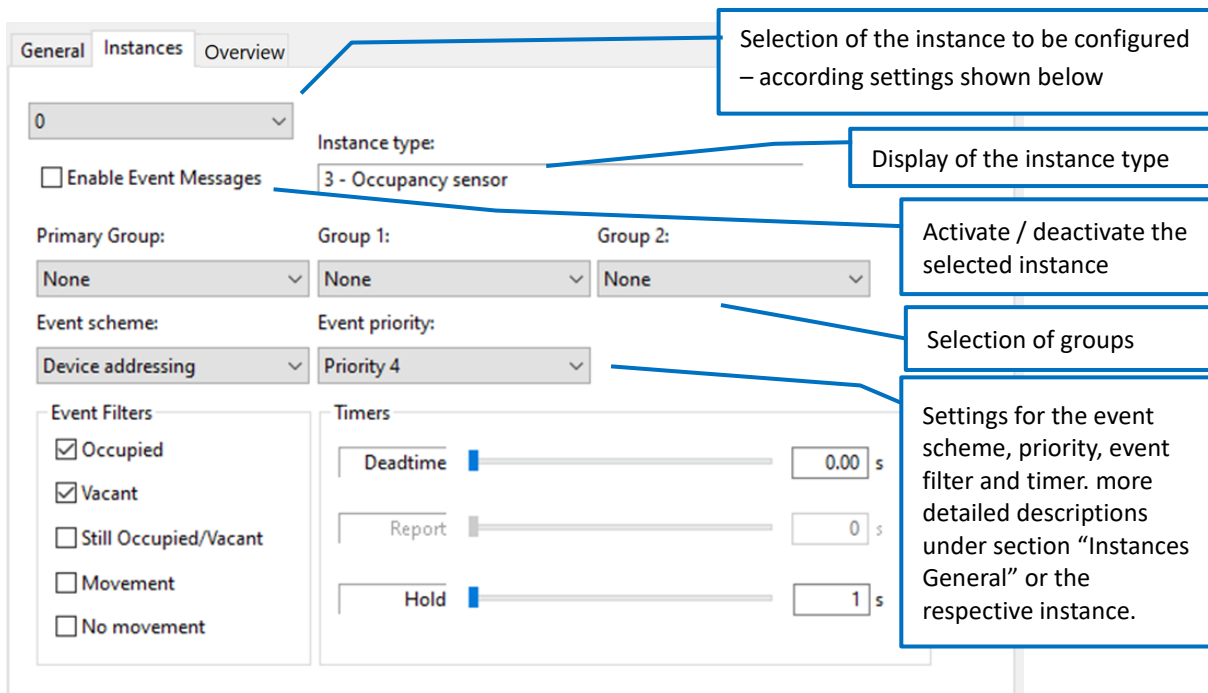


Figure. 7 Cockpit tab Instances - settings for each instance

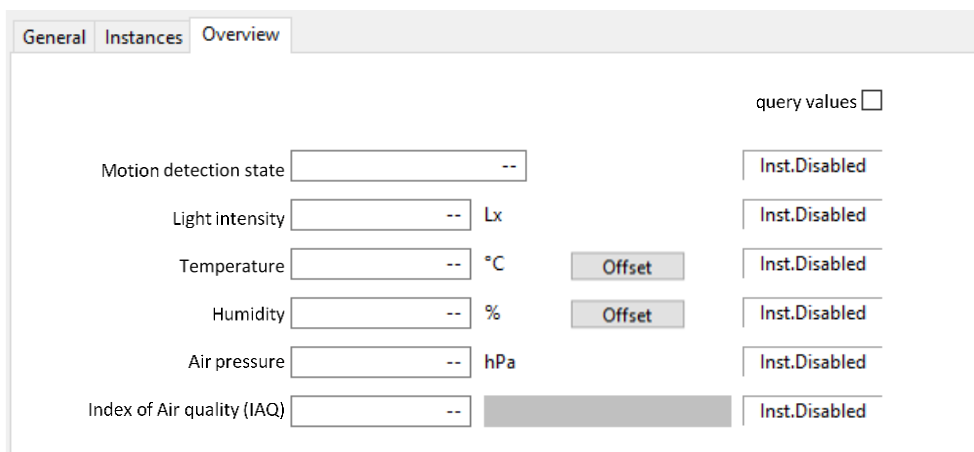


Figure. 8 Cockpit tab Overview - read and display the measured sensor values

### Example Query Sensor Values – generic Instances

The following examples show the evaluation of sensor values of the generic Lunatone instances based on the temperature instance. The same procedure also applies to air pressure, air quality, CO2 equivalent and humidity. For a technical description of all supported commands of the generic Lunatone instances see the detailed documentation "[Sensor Instance Manual](#)".

#### Query and evaluation of Temperature value:

The temperature value is made up of the input value and the input value latch. The number of relevant bits is specified via the resolution:

Query Resolution → answer: 0x0A  
 0x0A [hex] = 10 [dec]: the information is contained in 10 bits:

Query Input Value → answer: 0x6C  
 Query Input Value Latch → answer: 0x9B

0x6C = **0110 1100**  
 0x9B = **1001 1011**  
 → 0110 1100 10 = 434 [dec]

For the DALI-2 CS THP temperature sensor the resolution is 0.1°C, the value range is: -20°C to

+ 80°C (this information can be found in the sensor datasheet but can also be queried from the device, see next example for more information)

- $434 * 0.1^{\circ}C = 43.4^{\circ}C$
- $43.4^{\circ}C - 20^{\circ}C = 23.4^{\circ}C$

#### More details on temperature value query and evaluation

##### Details on Querying:

A query (24bit DALI frame) consists of:

device address*2+1	instancnr.	query command code
--------------------	------------	--------------------

In this example we have a sensor with:  
 DALI-2 address: A0<sup>2</sup>  
 temperature instance: instancnr. 2


Query command codes:

QUERY VALUE MULTIPLICATOR	0x40
QUERY VALUE DIVISOR	0x41
QUERY OFFSET MSB	0x42
QUERY OFFSET LSB	0x43
QUERY OFFSET MULTIPLICATOR	0x44
QUERY OFFSET DIVISOR	0x45
QUERY UNIT	0x46
QUERY RESOLUTION	0x81

QUERY Resolution

device address*2+1	instancenr.	query command code
01	02	81

Queries can be sent from the DALI Cockpit > DALI Bus > DALI Commands...:

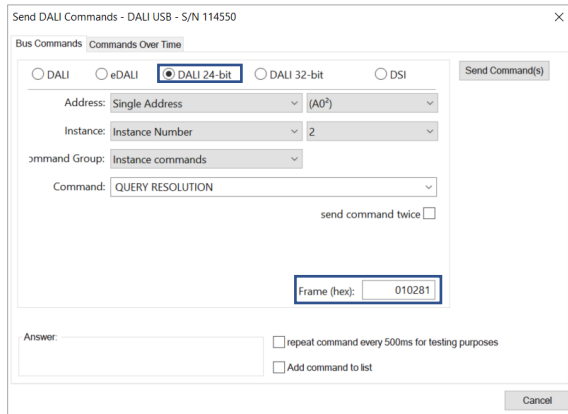

Type	Hex Data	Address	Command
DALI24 Inst Query	01 02 81	A0, iN2	QUERY RESOLUTION
DALI8 Answer	0A		= 10 (0x0A)
DALI24 Inst Query	01 02 8C	A0, iN2	QUERY INPUT VALUE
DALI8 Answer	6C		= 108 (0x6C)
DALI24 Inst Query	01 02 8D	A0, iN2	QUERY INPUT VALUE LATCH
DALI8 Answer	9B		= 155 (0x9B)

With the responses from the sensor, the calculation can be continued as in the first example.

**Details on Evaluation:**

Information on the resolution and value range is not only available from the data sheet but can also be queried:

The value is then made up as follows:

$$Value[unit] = Input\ Value \cdot \frac{Value\ Multiplier}{Value\ Divisor} + Offset \cdot \frac{Offset\ Multiplier}{Offset\ Divisor}$$

The read unit value can be assigned from the following table:

Wert	Einheit
0	Thermodynamic temperature [K]
1	CO <sub>2</sub> -eq (CO <sub>2</sub> equivalent) [ppm]
12	Relative humidity [%]
15	Barometric pressure [hPa]
16	IAQ (Indoor Air Quality) [1]

These values and assignment of units are specific to Lunatone sensors

Type	Hex Data	Address	Command
DALI24	01 02 40	A0, iN2	QUERY VALUE MULTIPLICATOR
DALI8 Answer	01		= 1 (0x01)
DALI24	01 02 41	A0, iN2	QUERY VALUE DIVISOR
DALI8 Answer	0A		= 10 (0x0A)
DALI24	01 02 42	A0, iN2	QUERY VALUE MSB
DALI8 Answer	62		= 98 (0x62)
DALI24	01 02 43	A0, iN2	QUERY VALUE LSB
DALI8 Answer	E3		= 227 (0xE3)
DALI24	01 02 44	A0, iN2	QUERY OFFSET MULTIPLICATOR
DALI8 Answer	01		= 1 (0x01)
DALI24	01 02 45	A0, iN2	QUERY OFFSET DIVISOR
DALI8 Answer	64		= 100 (0x64)
DALI24	01 02 46	A0, iN2	QUERY UNIT
DALI8 Answer	00		= 0 (0x00)

From the answers follows:

	[hex]	[dec]
Value Multiplier	0x01	1
Value Divisor	0x0A	10
Offset MSB und LSB	0x62E3	25315
Offset Multiplier	0x01	1
Offset Divisor	0x64	100
Unit	0x00	Kelvin

$$T[K] = Input\ Value \cdot \frac{1}{10} + 25315 \cdot \frac{1}{100}$$


$$= \frac{Input\ Value}{10} + 253.15$$

$$= \frac{434}{10} + 253.15 = 296.55\ K$$


$$T[°C] = T[K] - 273.15 = 23.4°C$$

## Purchase Order Information

### DALI-2 CS Integration: measurement of motion and light intensity

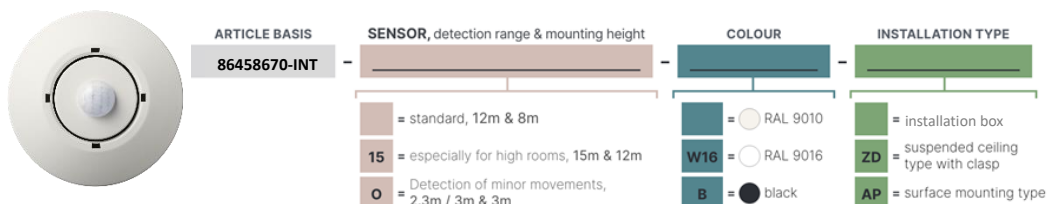

### DALI-2 CS THP Integration: measurement of motion, light intensity, temperature, humidity, air pressure and optional air quality (-AQ)

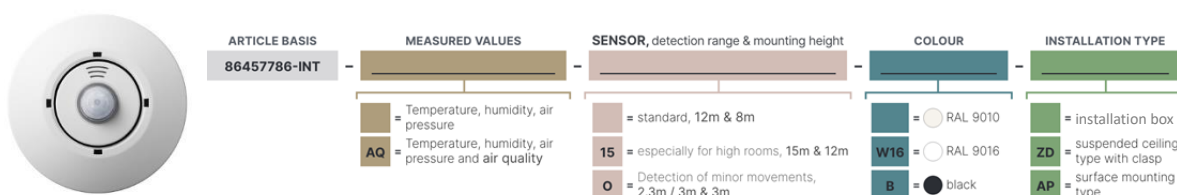

### Standard Version

**Art.Nr. 86458670-INT:** DALI-2 CS Integration

Sensor module: motion and light intensity;

Instance mode for Integration pure white (RAL9010), back box installation

- Art.Nr. 86458670-INT-AP:** pure white (RAL9010), surface mounting
- Art.Nr. 86458670-INT-ZD:** pure white (RAL9010), suspended ceiling (spring)
- Art.Nr. 86458670-INT-W16:** traffic white (RAL9016), back box installation
- Art.Nr. 86458670-INT-W16-AP:** traffic white (RAL9016), surface mounting
- Art.Nr. 86458670-INT-W16-ZD:** traffic white (RAL9016), suspended ceiling (spring)
- Art.Nr. 86458670-INT-B:** black, back box installation
- Art.Nr. 86458670-INT-B-AP:** black, surface mounting
- Art.Nr. 86458670-INT-B-ZD:** black, suspended ceiling (spring)

**Art.Nr. 86457786-INT:** DALI-2 CS Integration THP

Sensor module: motion and light intensity, temperature, humidity, air pressure

Instance mode for Integration, pure white (RAL9010), back box installation

- Art.Nr. 86457786-INT-AP:** pure white (RAL9010), surface mounting
- Art.Nr. 86457786-INT-ZD:** pure white (RAL9010), suspended ceiling (spring)
- Art.Nr. 86457786-INT-W16:** traffic white (RAL9016), back box installation
- Art.Nr. 86457786-INT-W16-AP:** traffic white (RAL9016), surface mounting
- Art.Nr. 86457786-INT-W16-ZD:** traffic white (RAL9016), suspended ceiling (spring)
- Art.Nr. 86457786-INT-B:** black, back box installation
- Art.Nr. 86457786-INT-B-AP:** black, surface mounting
- Art.Nr. 86457786-INT-B-ZD:** black, suspended ceiling (spring)

**Art.Nr. 86457786-INT-AQ:** DALI-2 CS Integration THP-AQ

Sensor module: motion and light intensity, temperature, humidity, air pressure, air quality, eCO2

Instance mode for Integration, pure white (RAL9010), back box installation

- Art.Nr. 86457786-INT-AQ-AP:** pure white (RAL9010), surface mounting
- Art.Nr. 86457786-INT-AQ-ZD:** pure white (RAL9010), suspended ceiling (spring)
- Art.Nr. 86457786-INT-AQ-W16:** traffic white (RAL9016), back box installation
- Art.Nr. 86457786-INT-AQ-W16-AP:** traffic white (RAL9016), surface mounting

**Art.Nr. 86457786-INT-AQ-W16-ZD:** traffic white (RAL9016), suspended ceiling (spring)

**Art.Nr. 86457786-INT-AQ -B:** black, back box installation

**Art.Nr. 86457786-INT-AQ -B-AP:** black, surface mounting

**Art.Nr. 86457786-INT-AQ -B-ZD:** black, suspended ceiling (spring)

### **Hall Version**

for halls / high ceilings: presence detection range 15m

**Art.Nr. 86458670-INT:** DALI-2 CS Integration, presence detection range 15m,

Sensor module: motion and light intensity

Instance mode for Integration, pure white (RAL9010), back box installation

**Art.Nr. 86458670-INT-15-AP:** pure white (RAL9010), surface mounting

**Art.Nr. 86458670-INT-15-ZD:** pure white (RAL9010), suspended ceiling (spring)

**Art.Nr. 86458670-INT-15-W16:** traffic white (RAL9016), back box installation

**Art.Nr. 86458670-INT-15-W16-AP:** traffic white (RAL9016), surface mounting

**Art.Nr. 86458670-INT-15-W16-ZD:** traffic white (RAL9016), suspended ceiling (spring)

**Art.Nr. 86458670-INT-15-B:** black, back box installation

**Art.Nr. 86458670-INT-15-B-AP:** black, surface mounting

**Art.Nr. 86458670-INT-15-B-ZD:** black, suspended ceiling (spring)

**Art.Nr. 86457786-INT-15:** DALI-2 CS Integration THP, presence detection range 15m,

Sensor module: motion and light intensity, temperature, humidity, air pressure

Instance mode for Integration, pure white (RAL9010), back box installation

**Art.Nr. 86457786-INT-15-AP:** pure white (RAL9010), surface mounting

**Art.Nr. 86457786-INT-15-ZD:** pure white (RAL9010), suspended ceiling (spring)

**Art.Nr. 86457786-INT-15-W16:** traffic white (RAL9016), back box installation

**Art.Nr. 86457786-INT-15-W16-AP:** traffic white (RAL9016), surface mounting

**Art.Nr. 86457786-INT-15-W16-ZD:** traffic white (RAL9016) suspended ceiling (spring)

**Art.Nr. 86457786-INT-15-B:** black, back box installation

**Art.Nr. 86457786-INT-15-B-AP:** black, surface mounting

**Art.Nr. 86457786-INT-15-B-ZD:** black, suspended ceiling (spring)

**Art.Nr. 86457786-INT-AQ-15:** DALI-2 CS Integration THP-AQ, presence detection range 15m,

Sensor module: motion and light intensity, temperature, humidity, air pressure, air quality, eCO2

Instance mode for Integration, pure white (RAL9010), back box installation

**Art.Nr. 86457786-INT-AQ-15-AP:** pure white (RAL9010), surface mounting

**Art.Nr. 86457786-INT-AQ-15-ZD:** pure white (RAL9010), suspended ceiling (spring)

**Art.Nr. 86457786-INT-AQ-15-W16:** traffic white (RAL9016), back box installation

**Art.Nr. 86457786-INT-AQ-15-W16-AP:** traffic white (RAL9016), surface mounting

**Art.Nr. 86457786-INT-AQ-15-W16-ZD:** traffic white (RAL9016), suspended ceiling (spring)

**Art.Nr. 86457786-INT-AQ-15-B:** black, back box installation

**Art.Nr. 86457786-INT-AQ-15-B-AP:** black, surface mounting

**Art.Nr.: 86457786-INT-AQ-15-B-ZD:** black, suspended ceiling (spring)

### **Office Version**

for office applications: detection of small movement / seated people

**Art.Nr. 86458670-INT:** DALI-2 CS Integration, for office applications (detection of seated persons)

Sensor module: motion and light intensity

Instance mode for Integration, pure white (RAL9010), back box installation

- Art.Nr. 86458670-INT-O-AP: pure white (RAL9010), surface mounting
- Art.Nr. 86458670-INT-O-ZD: pure white (RAL9010), suspended ceiling (spring)
- Art.Nr. 86458670-INT-O-W16: traffic white (RAL9016), back box installation
- Art.Nr. 86458670-INT-O-W16-AP: traffic white (RAL9016), surface mounting
- Art.Nr. 86458670-INT-O-W16-ZD: traffic white (RAL9016), suspended ceiling (spring)
- Art.Nr. 86458670-INT-O-B: black, back box installation
- Art.Nr. 86458670-INT-O-B-AP: black, surface mounting
- Art.Nr. 86458670-INT-O-B-ZD: black, suspended ceiling (spring)

**Art.Nr. 86457786-INT-O:** DALI-2 CS Integration THP , for office applications (detection of seated persons)  
 Sensor module: motion and light intensity, temperature, humidity, air pressure

Instance mode for Integration, pure white (RAL9010), back box installation

- Art.Nr. 86457786-INT-O-AP: pure white (RAL9010), surface mounting
- Art.Nr. 86457786-INT-O-ZD: pure white (RAL9010), suspended ceiling (spring)
- Art.Nr. 86457786-INT-O-W16: traffic white (RAL9016), back box installation
- Art.Nr. 86457786-INT-O-W16-AP: traffic white (RAL9016), surface mounting
- Art.Nr. 86457786-INT-O-W16-ZD: traffic white (RAL9016), suspended ceiling (spring)
- Art.Nr. 86457786-INT-O-B: black, back box installation
- Art.Nr. 86457786-INT-O-B-AP: black, surface mounting
- Art.Nr. 86457786-INT-O-B-ZD: black, suspended ceiling (spring)

**Art.Nr. 86457786-INT-AQ-O:** DALI-2 CS Integration THP-AQ, for office applications (detection of seated persons),  
 Sensor module: motion and light intensity, temperature, humidity, air pressure, air quality, eCO2


Instance mode for Integration, pure white (RAL9010), back box installation

- Art.Nr. 86457786-INT-AQ-O-AP: pure white (RAL9010), surface mounting
- Art.Nr. 86457786-INT-AQ-O-ZD: pure white (RAL9010), suspended ceiling (spring)
- Art.Nr. 86457786-INT-AQ-O-W16: traffic white (RAL9016), back box installation
- Art.Nr. 86457786-INT-AQ-O-W16-AP: traffic white (RAL9016), surface mounting
- Art.Nr. 86457786-INT-AQ-O-W16-ZD: traffic white (RAL9016), suspended ceiling (spring)
- Art.Nr. 86457786-INT-AQ-O-B: black, back box installation
- Art.Nr. 86457786-INT-AQ-O-B-AP: black, surface mounting
- Art.Nr. 86457786-INT-AQ-O-B-ZD: black, suspended ceiling (spring)

**Luminaire installation Version**

**DALI-2 CS THP Integration - for installation in luminaires:**

**measurement of motion, light intensity, temperature, humidity, air pressure and optional air quality (-AQ)**

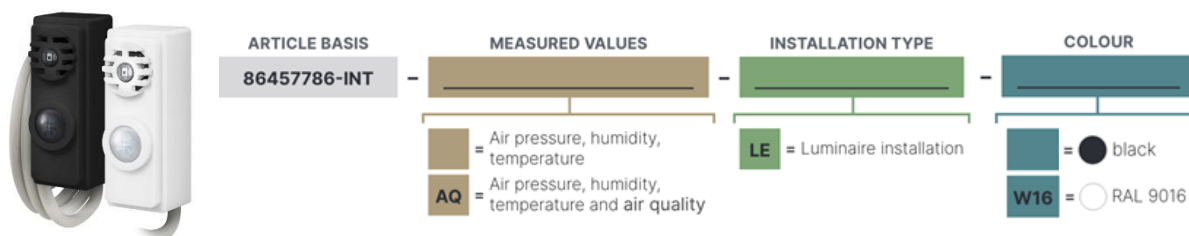

**Art.Nr. 86457786-INT-LE:** DALI-2 CS Integration THP for installation in luminaires,  
 Sensor module: motion and light intensity, temperature, humidity, air pressure  
 Instance mode for Integration, luminaire installation, black



**Art.Nr. 86457786-INT-AQ-LE:** DALI-2 CS Integration THP-AQ for installation in luminaires,  
Sensor module: motion and light intensity, temperature, humidity, air pressure, air quality, eCO2  
Instance mode for Integration, , luminaire installation, black

**Art.Nr. 86457786-INT-LE-W16:** DALI-2 CS Integration THP for installation in luminaires,  
Sensor module: motion and light intensity, temperature, humidity, air pressure  
Instance mode for Integration, luminaire installation, white RAL9016

**Art.Nr. 86457786-INT-AQ-LE-W16:** DALI-2 CS Integration THP-AQ for installation in luminaires,  
Sensor module: motion and light intensity, temperature, humidity, air pressure, air quality, eCO2  
Instance mode for Integration, , luminaire installation, white RAL9016

### **Version with Application Controller**

DALI-2 Combi Sensor: [www.lunatone.com/en/product/dali-2-cs/](http://www.lunatone.com/en/product/dali-2-cs/)

---

## Additional Information and Equipment

DALI-Cockpit – free configuration tool from Lunatone for DALI systems  
<https://www.lunatone.com/en/product/dali-cockpit/>

Lunatone sensor instance manual  
[https://www.lunatone.com/wp-content/uploads/2022/11/Lunatone\\_DALI-2\\_Sensor\\_Instances\\_EN\\_M0026.pdf](https://www.lunatone.com/wp-content/uploads/2022/11/Lunatone_DALI-2_Sensor_Instances_EN_M0026.pdf)

Instance guide  
[https://www.lunatone.com/wp-content/uploads/2021/10/DALI-2\\_Instance-Guide\\_EN\\_M0024.pdf](https://www.lunatone.com/wp-content/uploads/2021/10/DALI-2_Instance-Guide_EN_M0024.pdf)

Lunatone DALI products  
<http://www.lunatone.at/en/>

Lunatone datasheets and manuals  
<http://lunatone.at/en/downloads/>

## Contact

Technical Support: [support@lunatone.com](mailto:support@lunatone.com)

Requests: [sales@lunatone.com](mailto:sales@lunatone.com)

[www.lunatone.com](http://www.lunatone.com)



## Disclaimer

Subject to change. Information provided without guarantee.  
The datasheet refers to the current delivery.

The function in installations with other devices must be tested for compatibility in advance.